Project:

Test Bed Service GTR

Company:

Grundfos

control box design

DISTRIBUTOR LARGENESS:	400x600x200	(BxHxT)
COLOUR:	RAL 7032	
KIND OF PROVISION:	IP54	
DOOR:	right	

collor of circuit wiring

MAIN CURRENT WIRE 400/230V:		black
NEUTRAL WIRE:		blue
EARTH WIRE:		yelow/green
CONTROL VOLTAGE 230VAC:	L/N	brown/blue
CONTROL VOLTAGE 0-24VAC:	L/N	orange/white
CONTROL VOLTAGE 0-24VDC:	+/-	red/white
GND, DDC:		white
MEASURE WIRE, SENSOR:		green
POTENTIAL FREE WIRE:		violet
SEPARATE VOLTAGE:		violet

_ ! ! A T T E N T I O N ! ! _

If changes will be made in the distributor or external plugs which are not done by producer, guarantee will run out. Costs arising through it would not be admitted. If it becomes necessary, out of technical reasons, you have to inform the producer. Pay attention to local electricity provisions! Synchronize engine protection plugs to the current input of the engines and control all screws, terminals and plugs, if necessary they have to be tighten up, before putting into operation.

Page register

000 Front Page
001 GTR Test Panel 200Amp Ser.No.971024/3
002 FBD Controlbox for Sensors GTR Service

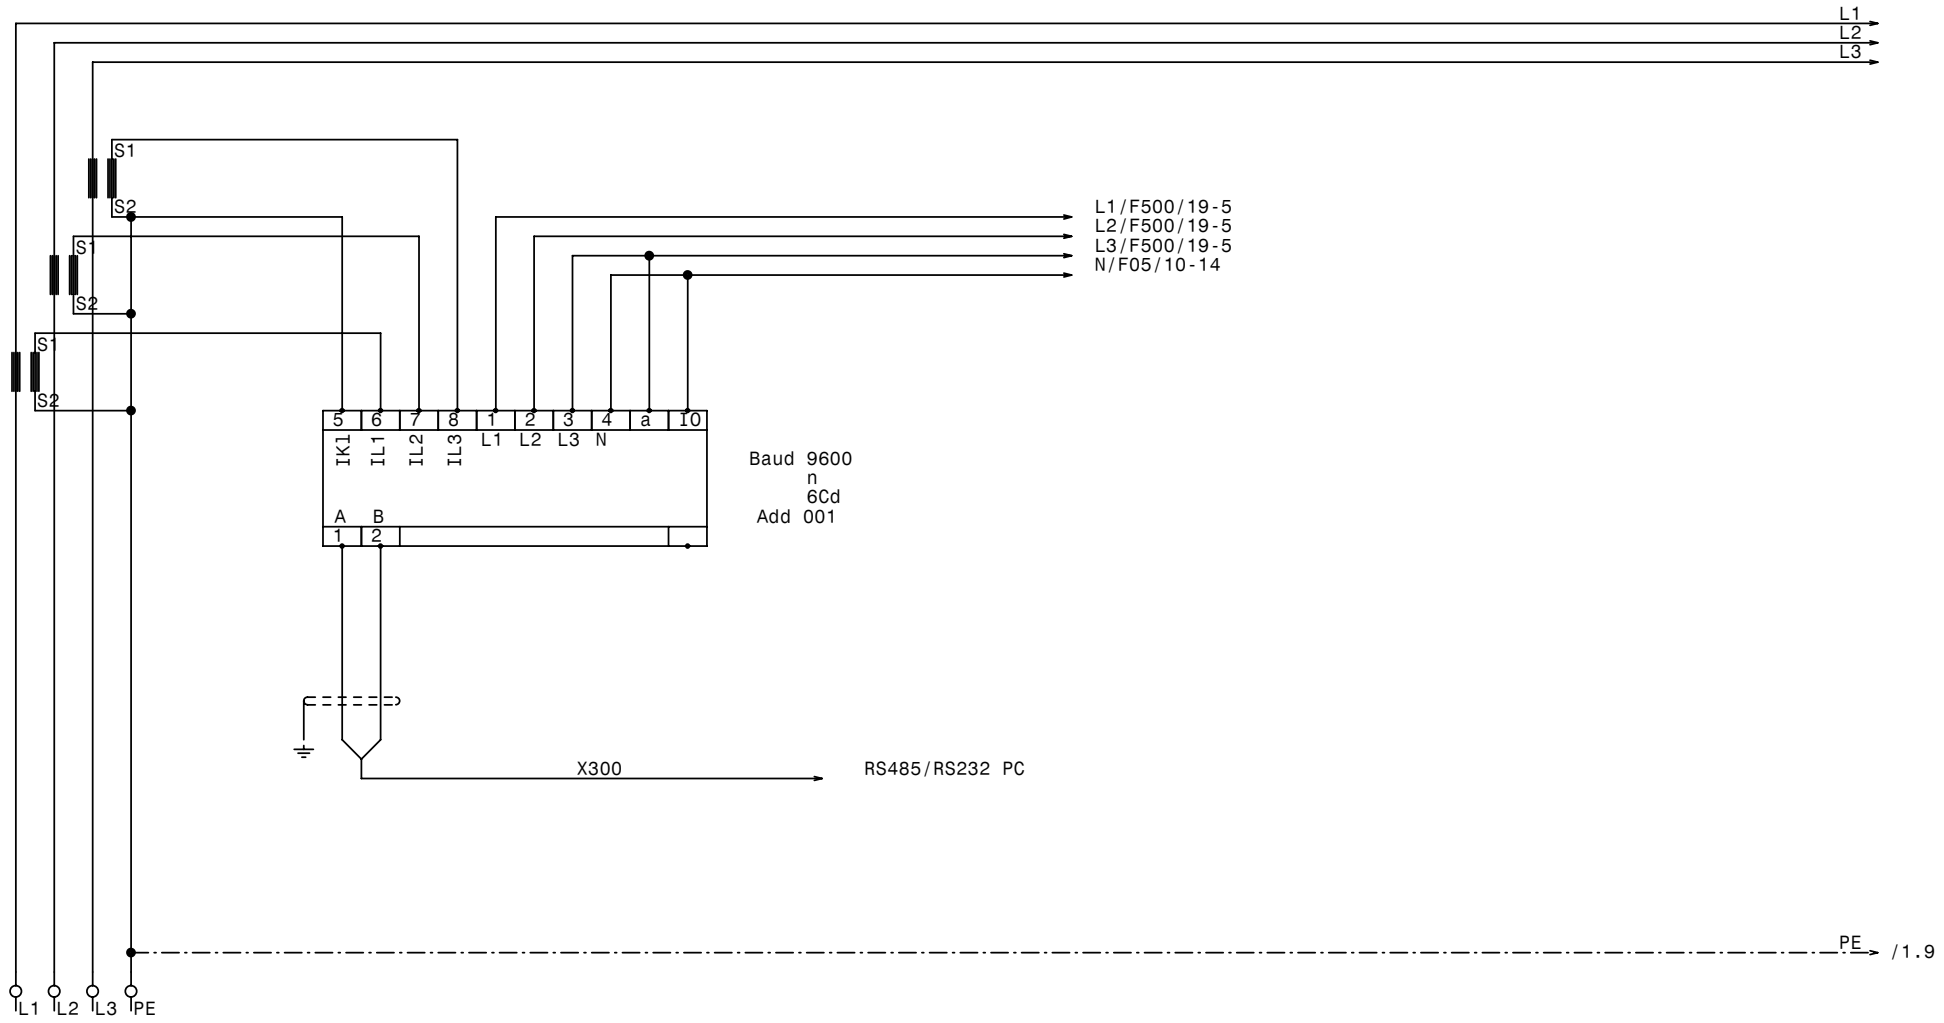

Page 5
Mains Supply
250A

GRUNDFOS	Datum	13.10.07	ELEKTRO ANLAGENBAU	Test Bed Service GTR GTR Test Panel 200Amp Ser.No.971024/36/97	Zeichn.Nr.: 262/07 Blatt 1
	Bearb.	Hattinger			
	Gepr.				
	Norm				

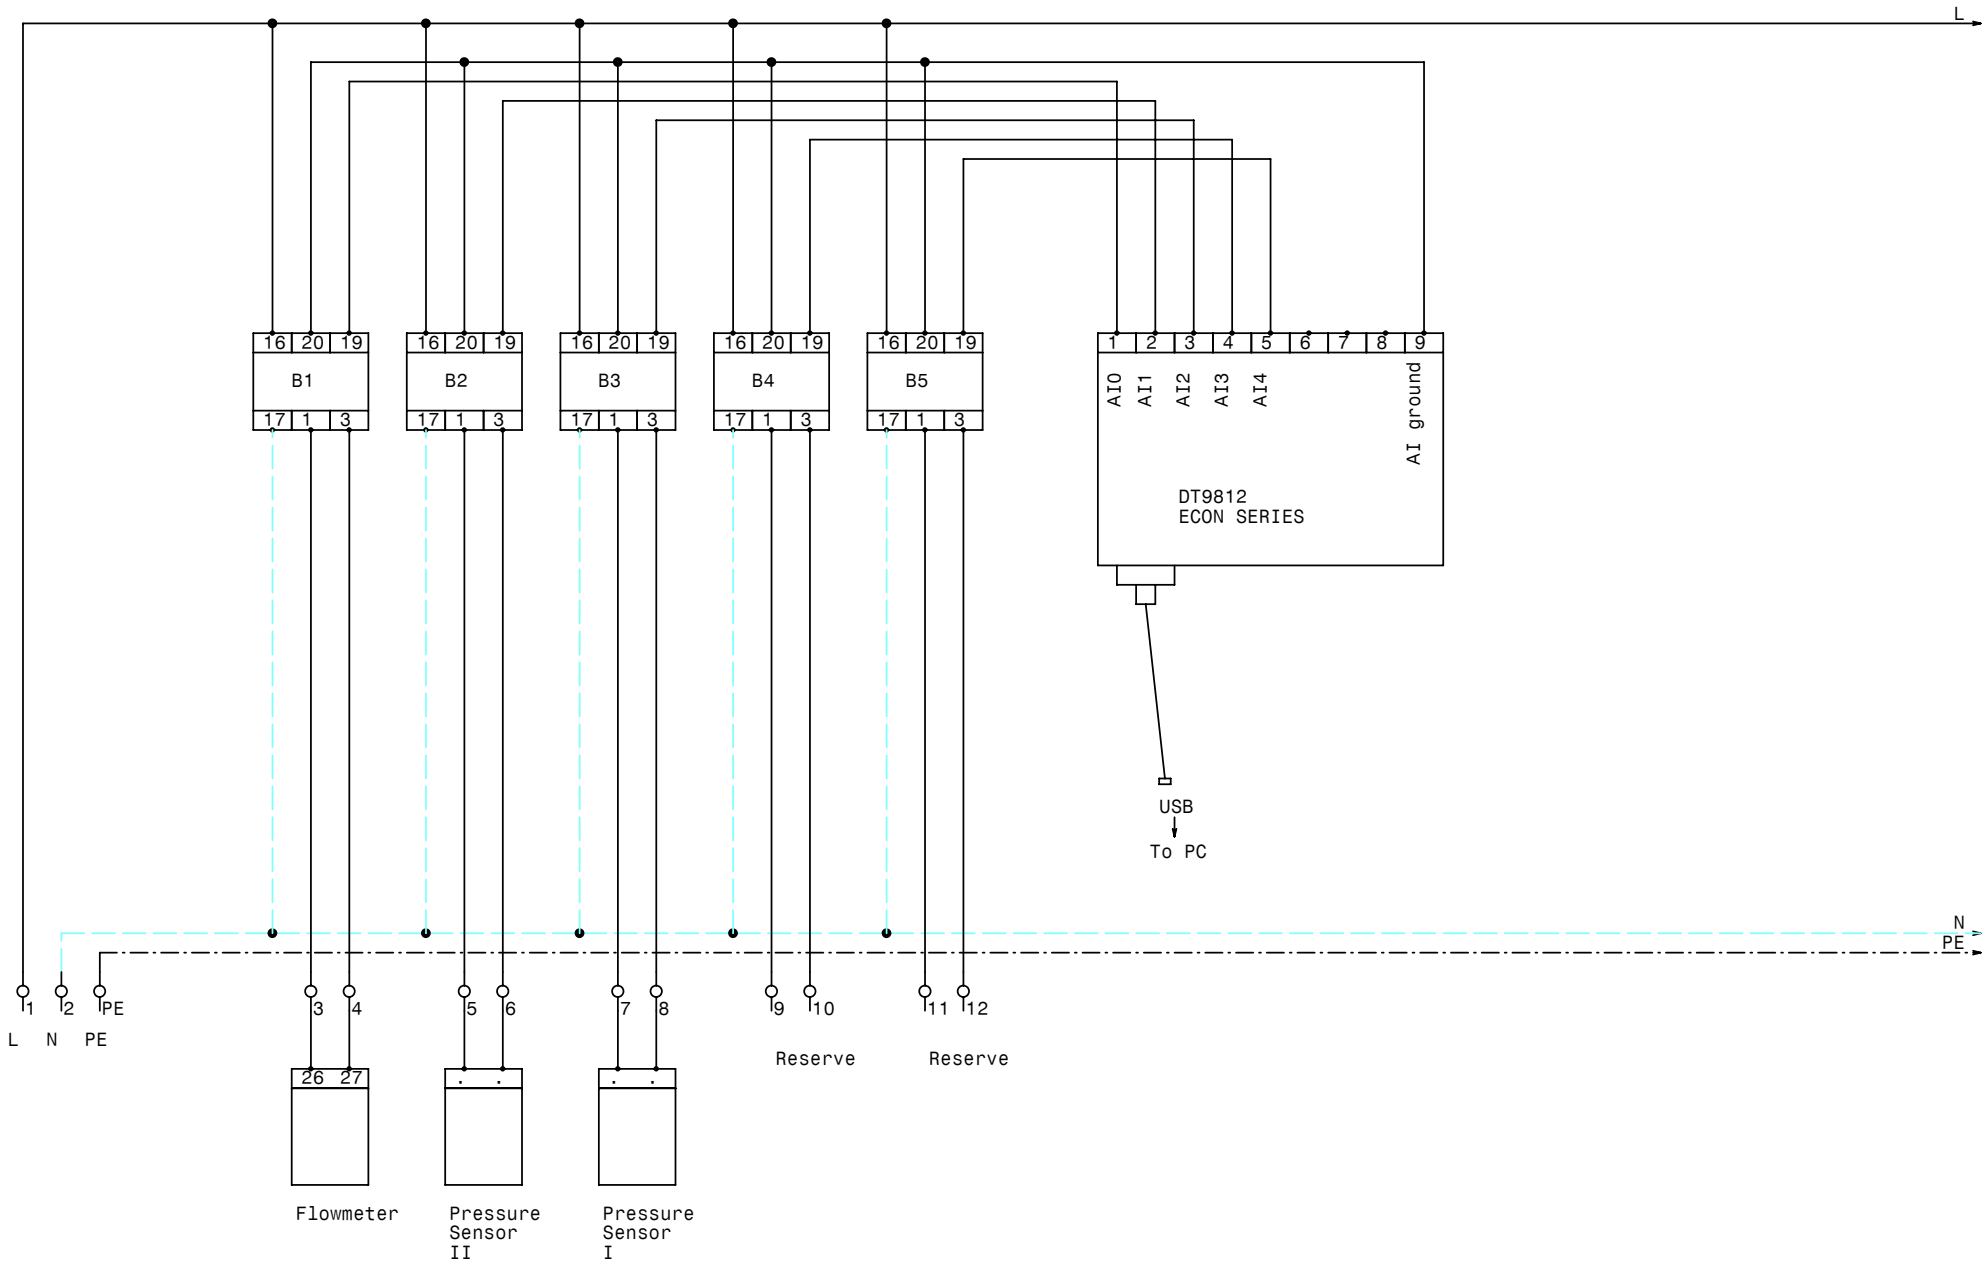

GRUNDFOS	Datum	04.12.07	elpe ELEKTRO ANLAGENBAU	Test Bed Service GTR FBD Controlbox for Sensors GTR Service	Zeichn.Nr.: 262/07 Blatt 2
	Bearb.	Hattinger			
	Gepr.				
	Norm				

www.elpe.net www.elpe.net www.elpe.net www.elpe.net www.elpe.net www.elpe.net www.elpe.net www.elpe.net www.elpe.net www.elpe.net

0	1	2	3	4	5	6	7	8	9

Prüfstand Software Reportiny System

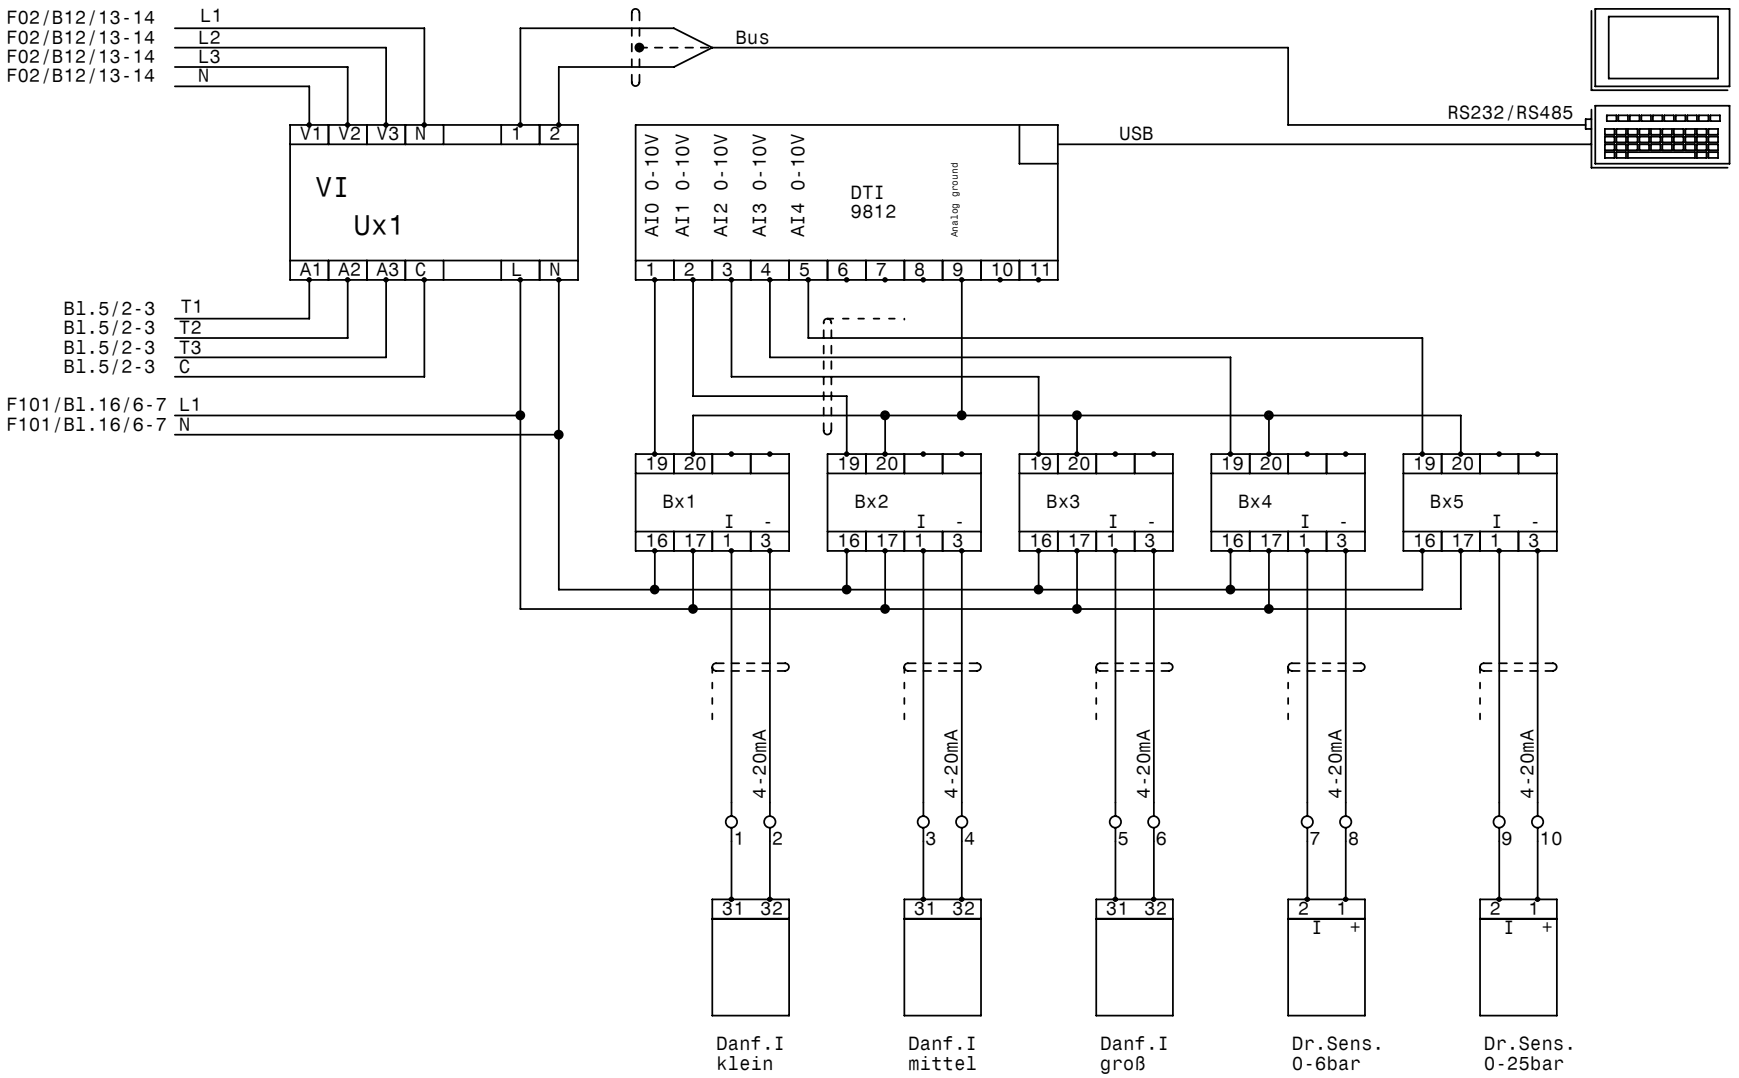

Zu Zeichnung Nr.: 994086

GRUNDFOS	Datum	03.12.07	elpe ELEKTRO ANLAGENBAU	Prüfstand AP	Zeichn.Nr.: 262/07
	Bearb.	Hattinger			Blatt
	Gepr.				
	Norm				

www.elpe.net www.elpe.net www.elpe.net www.elpe.net www.elpe.net www.elpe.net www.elpe.net www.elpe.net www.elpe.net www.elpe.net

Prüfstand Software Reportiny System

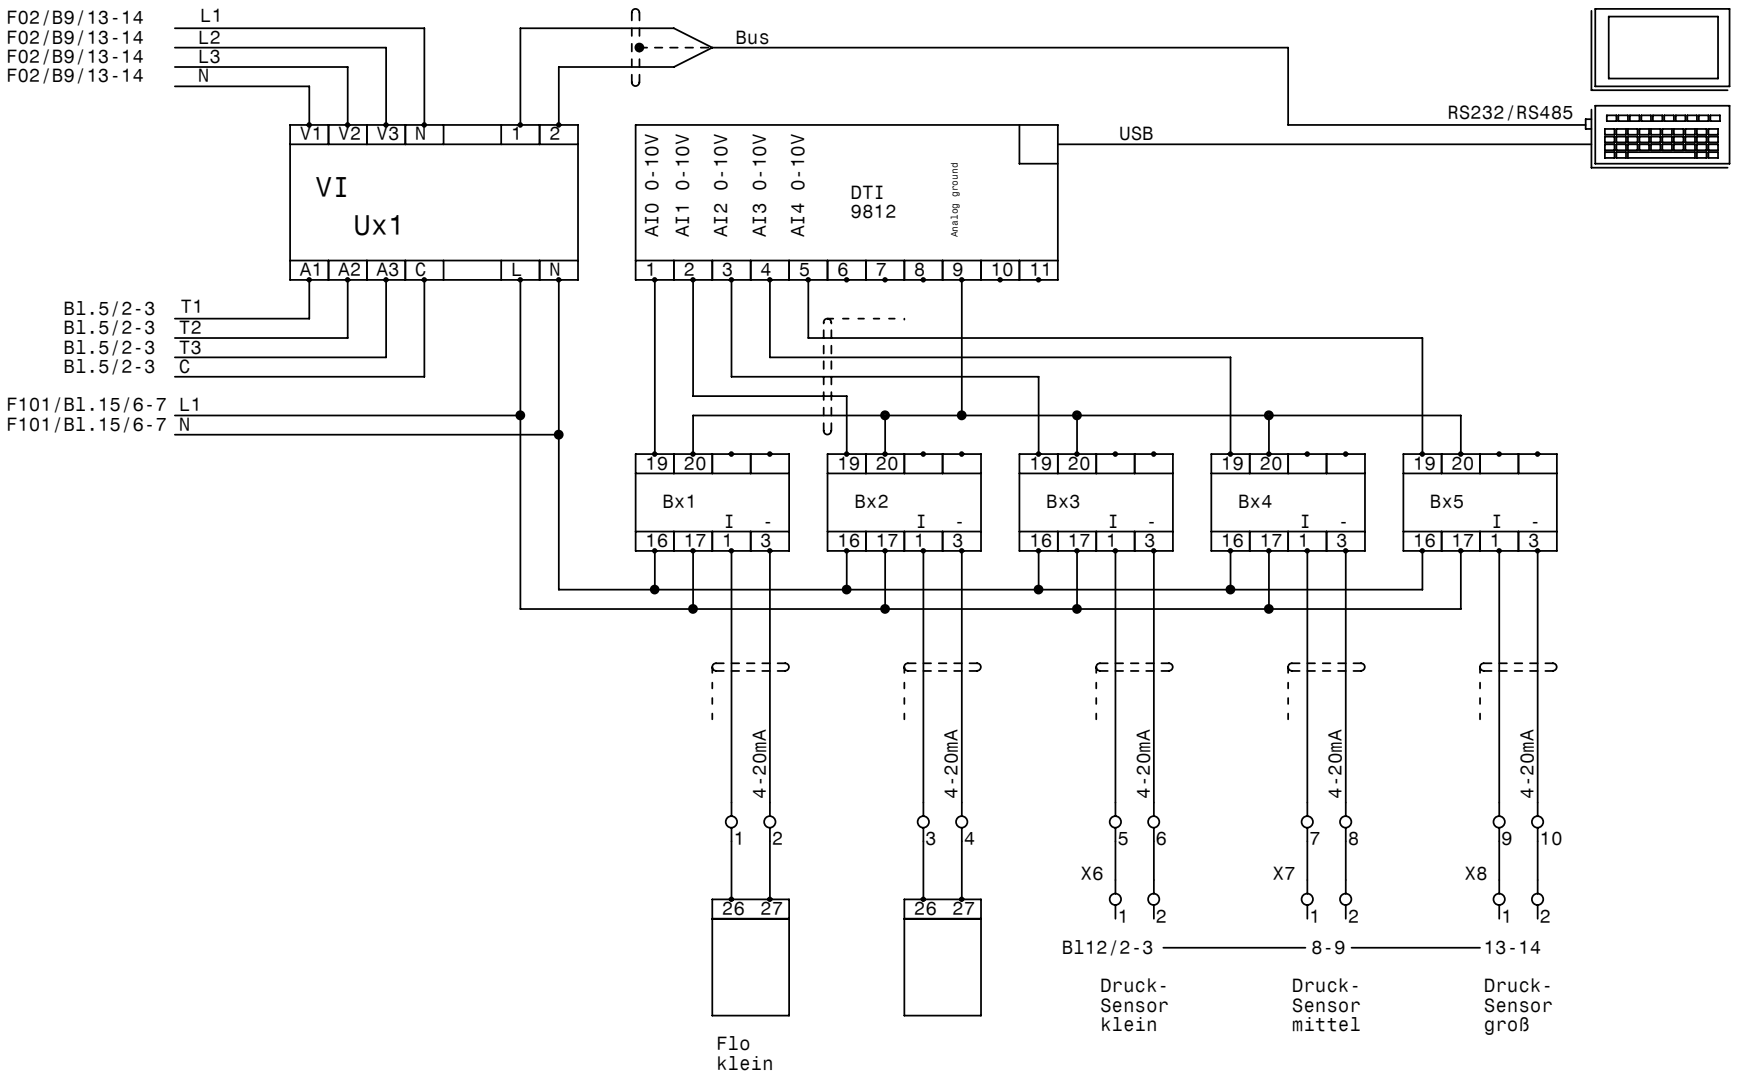

Zu Zeichnung Nr.: 204/45

GRUNDFOS	Datum 03.12.07	elpe ELEKTRO ANLAGENBAU	Prüfstand SP CR	Zeichn.Nr.: 262/07
	Bearb. Hattinger			Blatt 12a
	Gepr.			
	Norm			

Prüfstand Software Reportiny System

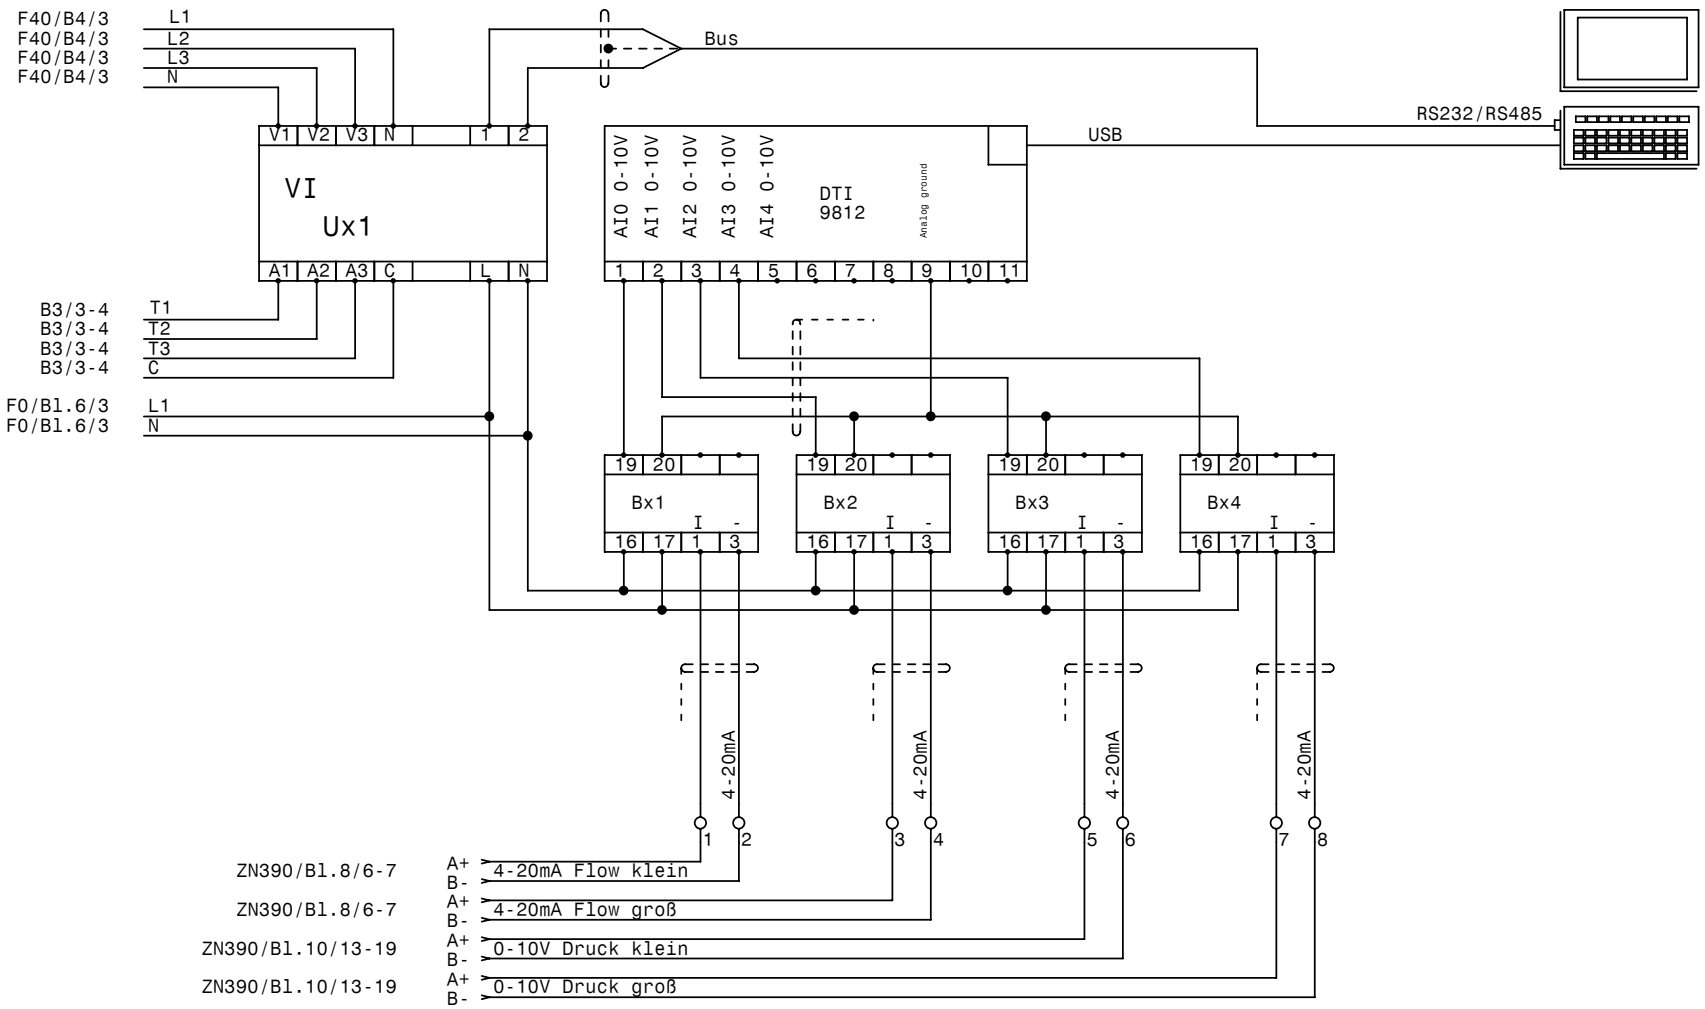

Zu Zeichnung Nr.: 390

GRUNDFOS	Datum	03.12.07	elpe ELEKTRO ANLAGENBAU	Prüfstand SP groß	Zeichn.Nr.: 262/07
	Bearb.	Hattinger			Blatt 10a
	Gepr.				
	Norm				

0	1	2	3	4	5	6	7	8	9

Prüfstand Software Reportiny System

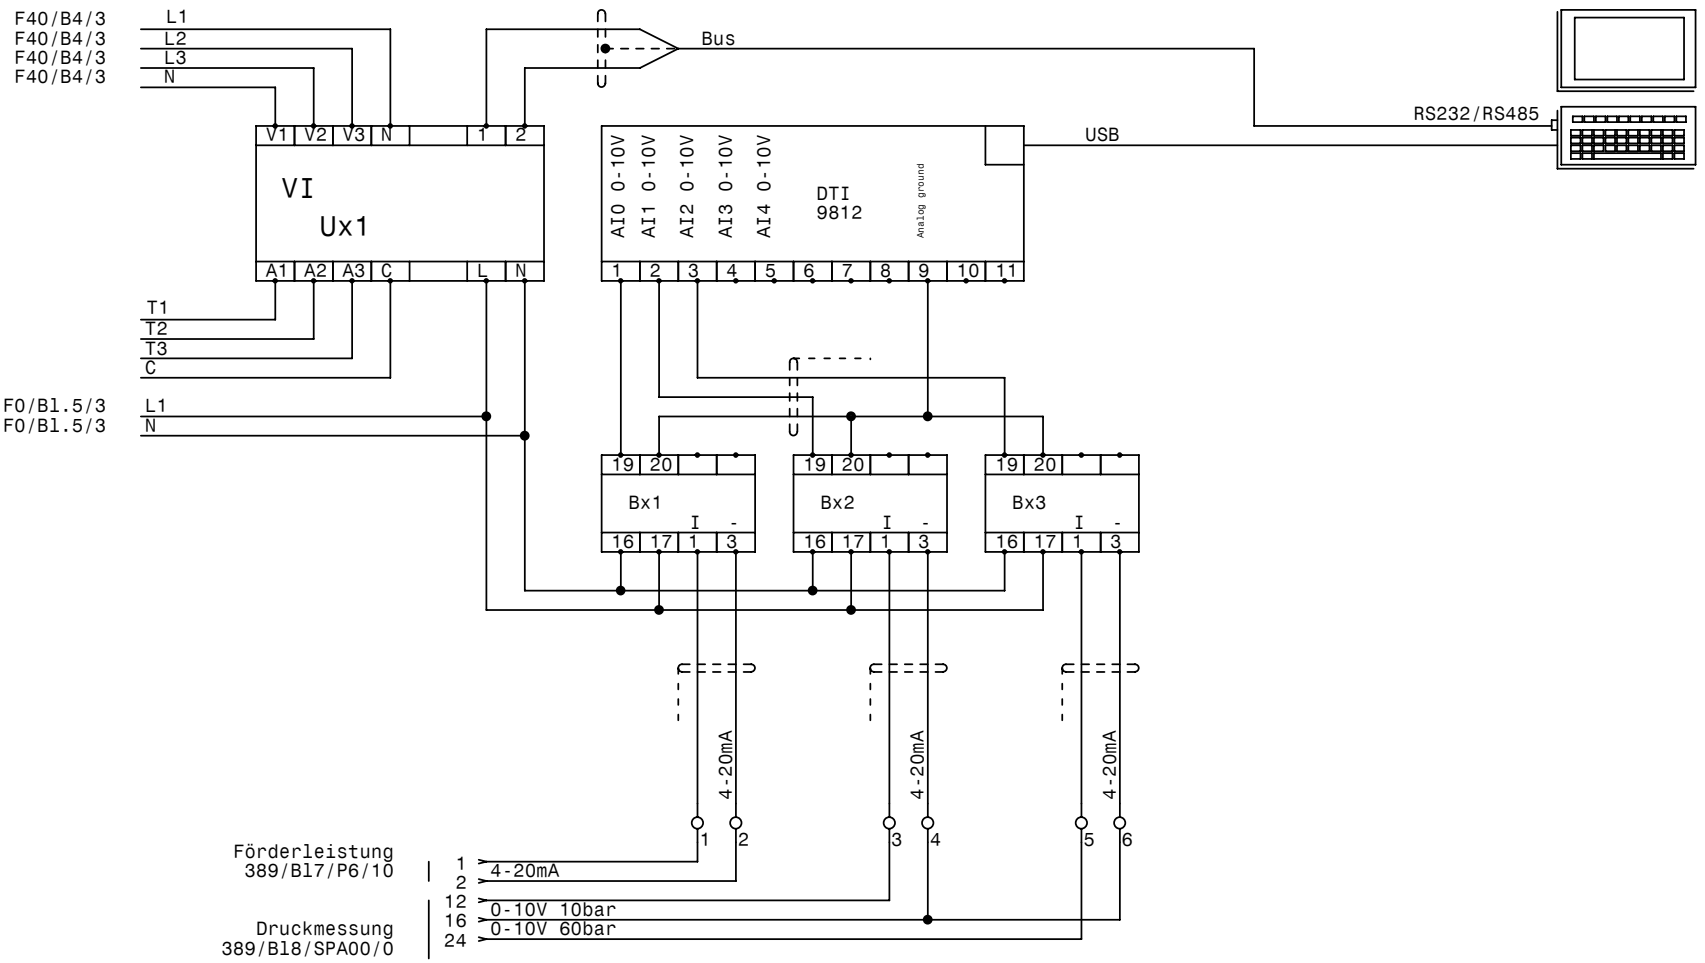

Zu Zeichnung Nr.: 389

GRUNDFOS	Datum	03.12.07	elpe ELEKTRO ANLAGENBAU	Prüfstand SP klein	Zeichn.Nr.: 262/07
	Bearb.	Hattinger			Blatt 7a
	Gepr.				
	Norm				

www.elpe.net www.elpe.net www.elpe.net www.elpe.net www.elpe.net www.elpe.net www.elpe.net www.elpe.net www.elpe.net www.elpe.net